

SECTION 009113 – ADDENDUM ONE

PART 1 - ADDENDA

1.1 PROJECT INFORMATION

- A. Project Identification: Leland Football Stadium Renovations Rebid
- B. Owner: Leland School District
- C. Architect: Dale | Bailey, an Association
- D. Architect Project Number: 19111.02
- E. Date of Addendum One: 1 September 2021

1.2 NOTICE TO BIDDERS

- A. This Addendum is issued to all registered plan holders pursuant to the Instructions to Bidders and Conditions of the Contract. This Addendum serves to clarify, revise, and supersede information in the Project Manual, Drawings, and previously issued Addenda. Portions of the Addendum affecting the Contract Documents will be incorporated into the Contract by enumeration of the Addendum in the Owner/Contractor Agreement.
- B. The Bidder shall acknowledge receipt of this Addendum in the appropriate space on the Bid Form.
- C. The date for receipt of bids is UNCHANGED by this Addendum.

1.3 REVISIONS TO DRAWING SHEETS



- A. Electrical Sheets:
 - 1. Replace Sheet E-101 ELECTRICAL RENOVATION SITE PLAN with new E-101 Addendum #1 dated 09/01/2021. Plan was unreadable in original set.

1.5 ATTACHMENTS

- A. Sheet E-101 Electrical Renovation Site Plan dated 01 September 2021.

END OF ADDENDUM ONE



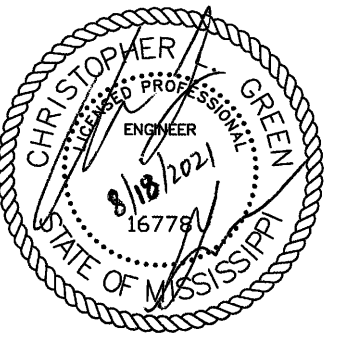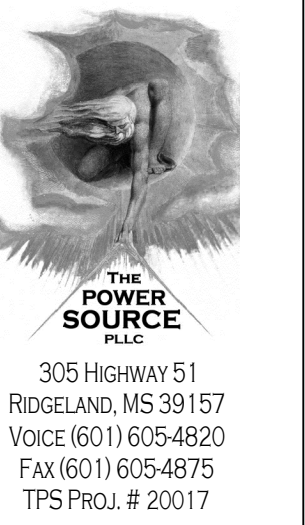


GENERAL NOTES	
Mark	Description
1.	DO NOT ROUTE POLE LIGHT CIRCUITS ACROSS THE FIELD. ROUTE CIRCUITS AROUND THE PERIMETER OF THE FIELD.
2.	LIGHTING MANUFACTURER'S REPRESENTATIVE SHALL PROVIDE A POINT BY POINT FIXTURE AIMING GRID AND ACCOMPANY/ASSIST THE ELECTRICAL CONTRACTOR DURING FIXTURE AIMING. NOTIFY THE ENGINEER OF THE DATE OF FIXTURE AIMING AND TESTING.
3.	ALL MUSCO FIELD LIGHTING AND POWER TO FIELD LIGHTING ARE ALTERNATE #1. IF ALTERNATE #1 IS NOT TAKEN, ALL EXISTING FIELD LIGHTS, FEEDERS, DISCONNECTS, AND EXISTING OVERHEAD LINES SHALL REMAIN.

MASTER KEYED NOTES	
Mark	Description
①	DEMOLISH EXISTING LIGHTS, EXISTING WOOD POLES, AND OVERHEAD CONDUCTORS IF ALTERNATE #3 IS TAKEN.
②	RECONNECT ALL EXISTING SCOREBOARD EQUIPMENT TO NEW PRESS BOX IF ALTERNATE #4 IS TAKEN.
③	RECONNECT ALL EXISTING SPEAKER EQUIPMENT TO NEW PRESS BOX IF ALTERNATE #4 IS TAKEN.

NOTE:
IF A KEYED NOTE IS NOT SHOWN ON A DRAWING, THEN THE KEYED NOTE SHALL BE IGNORED FOR THAT PARTICULAR DRAWING. THIS SHALL DIFFER FROM DRAWING TO DRAWING.

LINE LEGEND	
Mark	Description
-OHP-	OVERHEAD PRIMARY
-OHS-	OVERHEAD SECONDARY
-EOHP-	EXISTING OVERHEAD PRIMARY

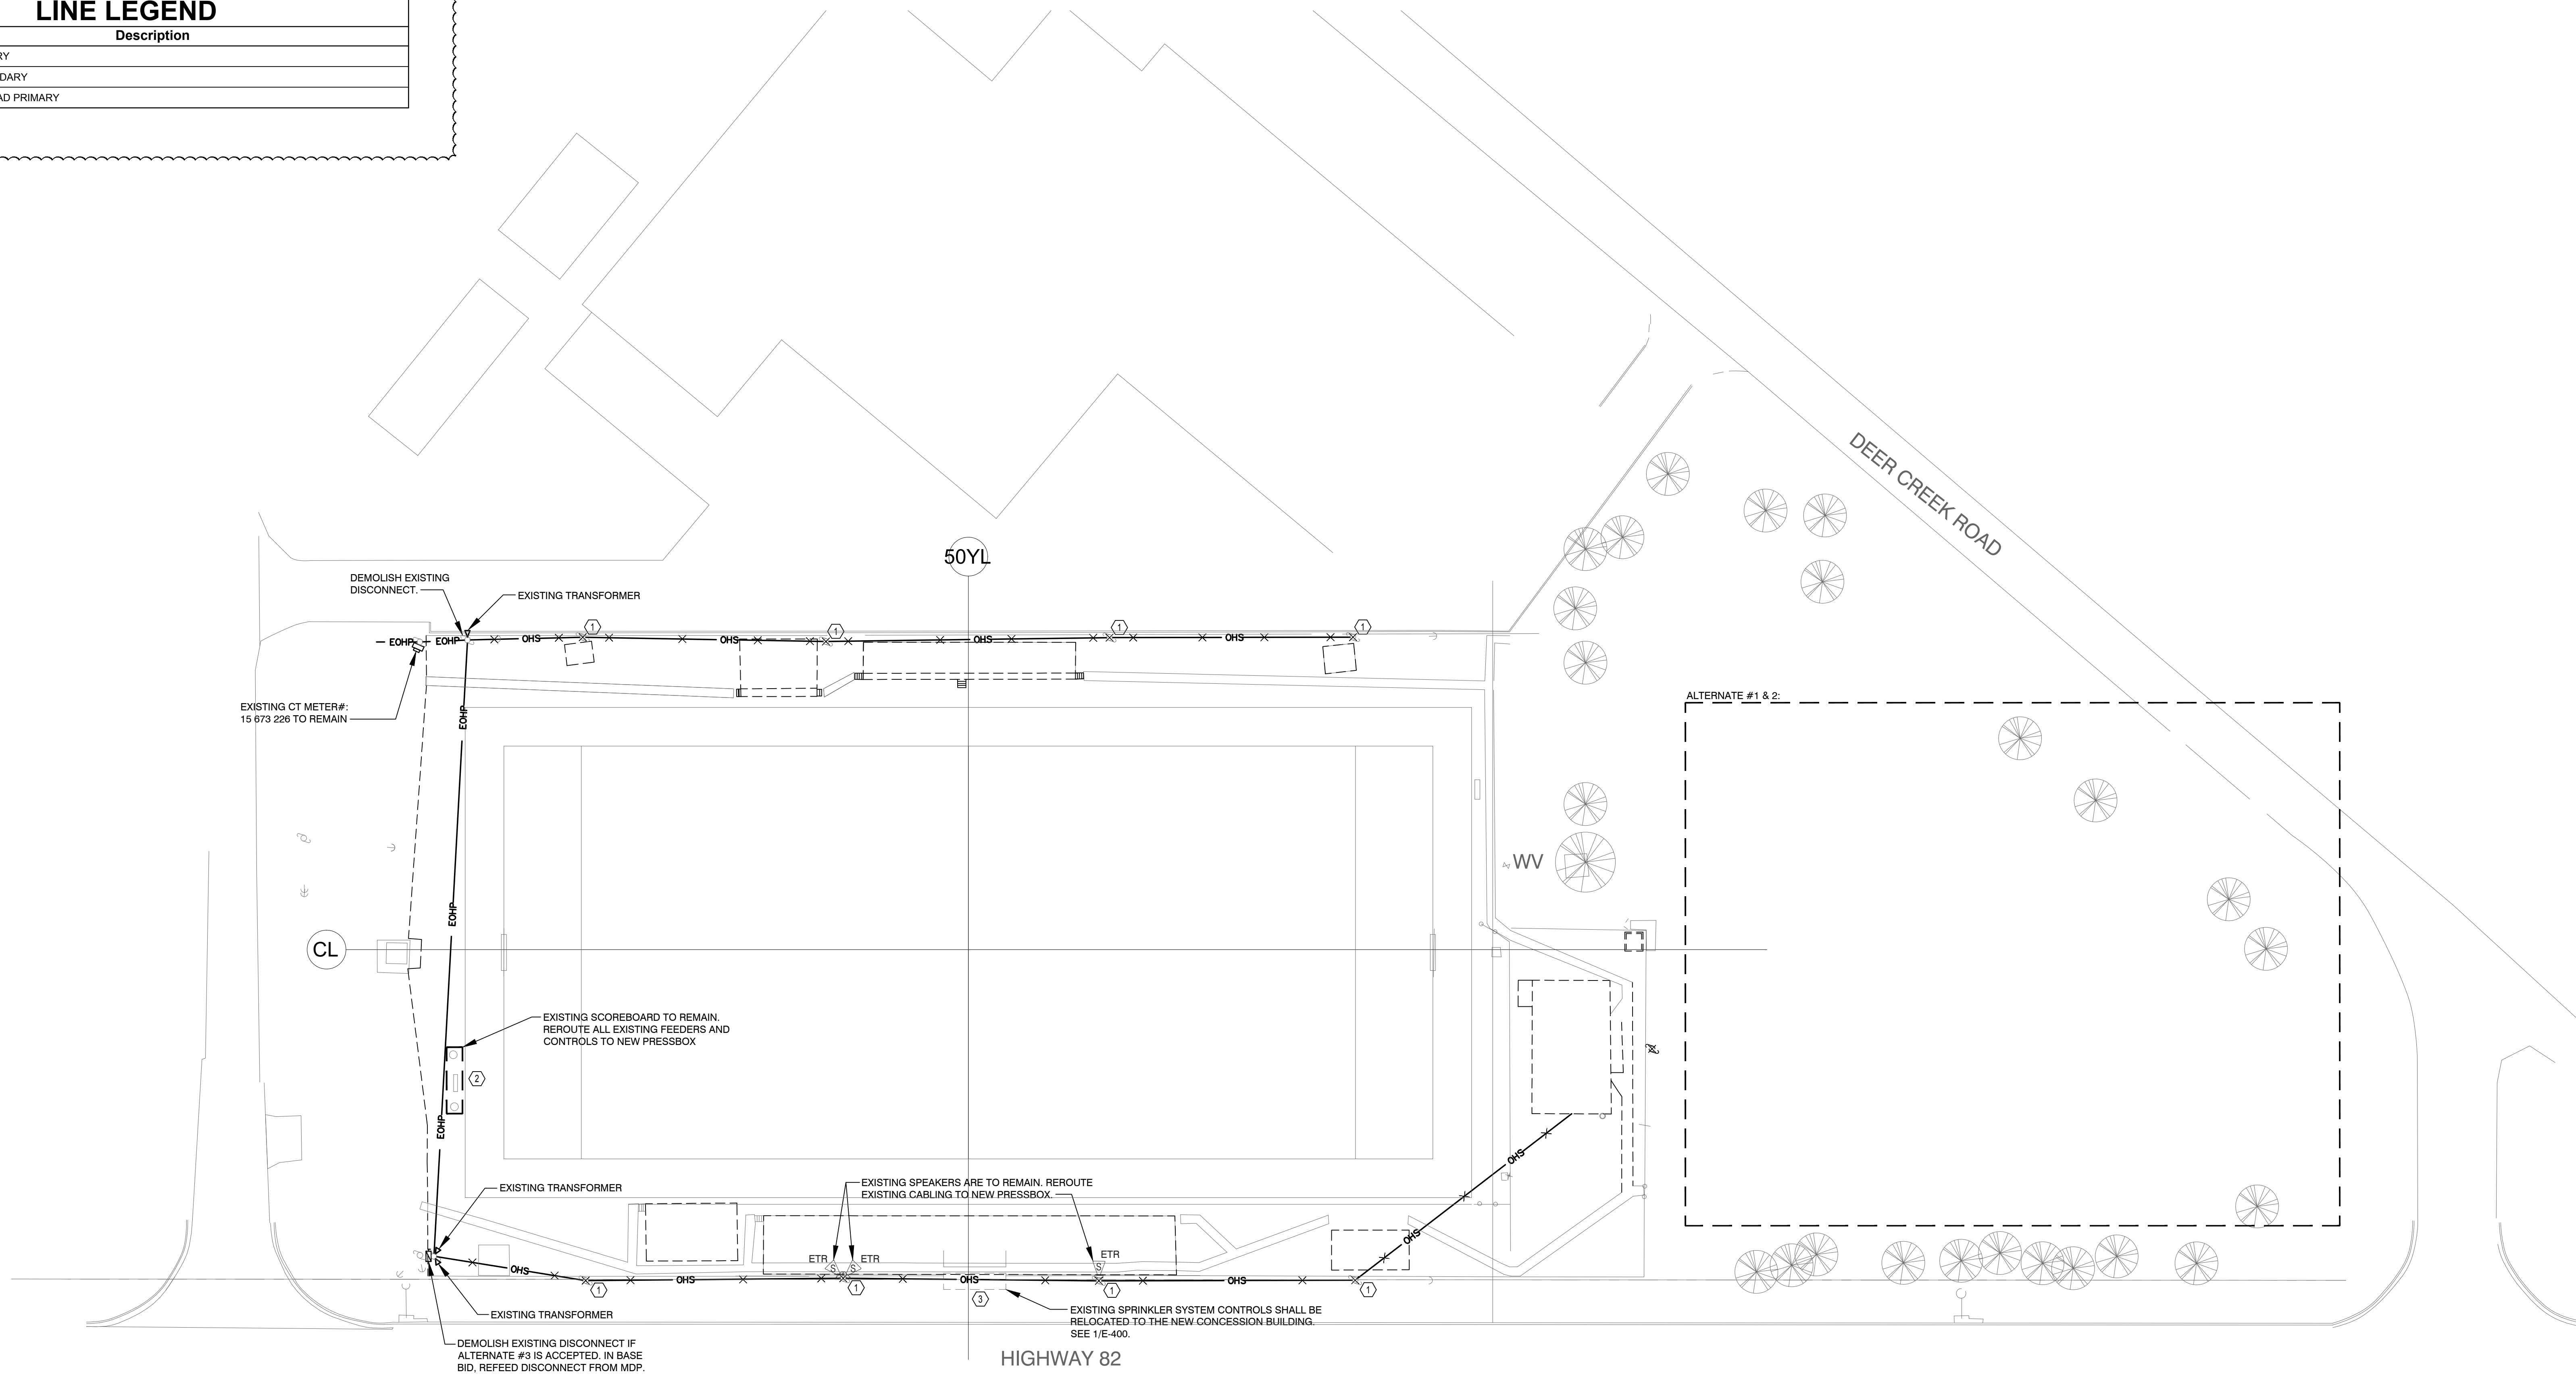

E101 ELECTRICAL DEMOLITION SITE PLAN - ALTERNATES
Scale: 1" = 30'-0"